

PFAS Drinking Water Characterization Study

**Per- and Polyfluoroalkyl Substances (PFAS)
Drinking Water Sampling Results**

August 2021 -February 2022

Published by the
Philadelphia Water Department
Dated as of March 2023¹



¹ The information contained herein is dated as of March 2023 and is subject to change without notice.
The Philadelphia Water Department undertakes no obligation to update the information contained herein as a result of any future changes or regulations.

Executive Summary

The Philadelphia Water Department (PWD) works to ensure the integrity of our source waters and drinking water. Our protection efforts include voluntary, proactive testing for emerging contaminants such as PFAS. From 2019 to 2021, PWD monitored source waters for in-stream concentrations of PFAS. These results are published in the *PFAS Water Resources Characterization Study* (updated September 2021). No samples of raw water taken at PWD's drinking water treatment plant intakes exceeded the contemporaneous EPA Health Advisory Level of 70 parts per trillion for PFOA and PFOS combined.

This report, the *PFAS Drinking Water Characterization Study*, presents results from finished drinking water sampled in 2021 and 2022. The state of Pennsylvania has proposed maximum contaminant levels (MCLs) for PFOA and PFOS in drinking water. **No samples of finished drinking water exceed the proposed state MCLs for PFOS or PFOA.**

Overview

PFAS, which stands for per- and polyfluoroalkyl substances, are a group of more than 9,000 human-made chemicals that have been widely used around the world since the mid-20th century to manufacture industrial and consumer products including cookware, fabrics, furniture, paper goods and firefighting foams. Because they are resistant to heat, oil, and water, they do not break down easily and can remain in the environment for decades. In recent years, these contaminants have gained international attention as they've been detected in soil, water, air, and living organisms including the human body across the world—even in remote locations such as the Arctic. In short, they are all around us.

Exposure to certain types of PFAS substances can have adverse effects on your health. Studies have linked two of the most found and widely studied PFAS compounds—perfluorooctane sulfonate (PFOS) and perfluorooctanoic acid (PFOA)—to detrimental effects on the immune and cardiovascular systems, as well as decreased birth weight and cancer.

In November 2021, the state of Pennsylvania proposed regulatory limits of 14 parts per trillion (ppt) for PFOA and 18 ppt for PFOS in drinking water to protect human health. In 2021 and 2022, PWD voluntarily monitored PFAS levels at its three drinking water treatment plants. The results are summarized below. **No samples exceeded the proposed state limits for PFOA or PFOS as currently in effect as of the date hereof/as then in effect on the date of such sampling.**

Sampling Locations and Methodology

From August 16, 2021 to February 28, 2022, drinking water samples were collected approximately biweekly at PWD's three drinking water treatment plants: Baxter, Queen Lane, and Belmont (Figure 1). Baxter draws water from the Delaware River, and Queen Lane and Belmont draw water from the Schuylkill River. Fifteen samples were taken at each sampling point. Each sample consisted of finished, or treated, drinking water collected from the final storage basin (sometimes called a

clearwell) at the plant before being conveyed through the distribution system. At Queen Lane, two sample locations were chosen (the North and South clearwells, referred to as Queen Lane 1 and Queen Lane 2, respectively) to compare results from the same plant. The samples from the two Queen Lane locations consist of the same source water and undergo the same level of treatment.

These samples were analyzed for concentrations of 14 different PFAS compounds (including PFOS and PFOA) [using EPA Method 537.1](#). The appendix contains complete laboratory results and refers to each sampling location by its Site ID listed in Table 1. Many samples fell below the minimum reporting limit (MRL), the smallest concentration that can be reliably measured. The MRL for this data set ranges from 1.7 ng/L to 2.0 ng/L (one nanogram per liter, or ng/L, is equivalent to one part per trillion, or ppt). Results below the MRL are referred to as non-detects, as their presence could not be detected by the laboratory method of analysis.

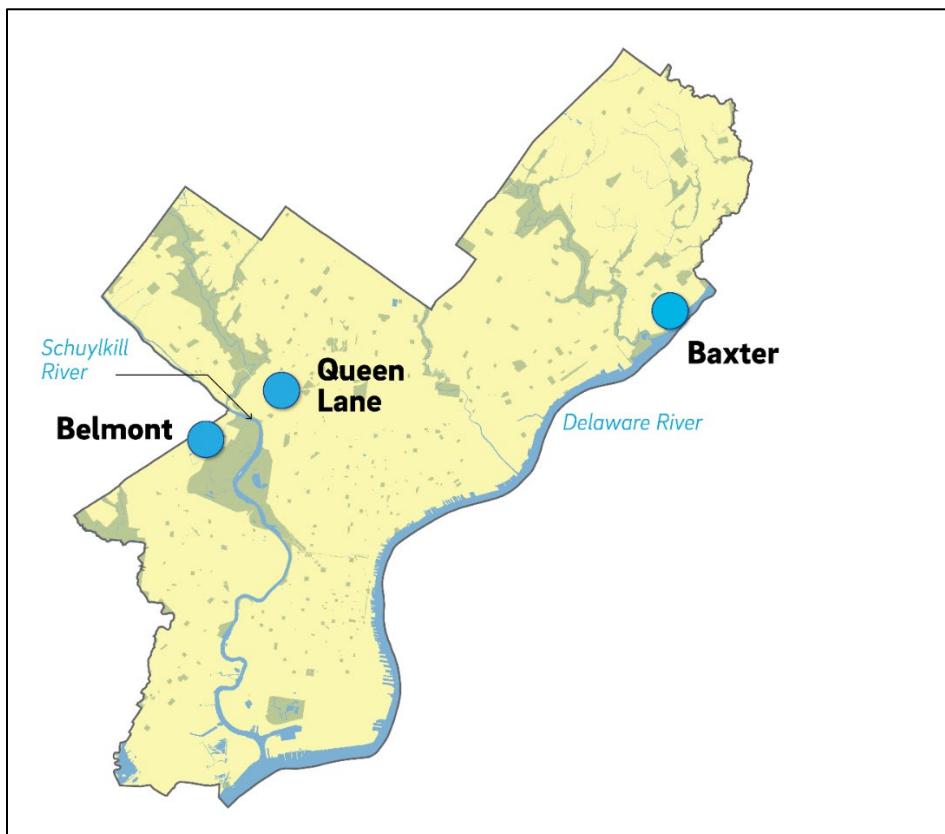


Figure 1. PFAS Drinking Water Characterization Sampling Site Locations

Table 1. PFAS Drinking Water Characterization Sampling Site Descriptions

Location Description	Site Name
Baxter Finished Water Storage	Baxter
Queen Lane North Clearwell	Queen Lane 1
Queen Lane South Clearwell	Queen Lane 2
Belmont Clearwell	Belmont

Results Summary: PFOS

Samples collected from the Baxter drinking water treatment plant demonstrated an average PFOS concentration of 3.1 ppt, with results ranging from non-detection (for 8 samples) to a maximum of 5.3 ppt. Results from the two locations at the Queen Lane treatment plant were comparable. At Queen Lane 1, average PFOS concentration was 4.9 ppt, ranging from 3.8 ppt to 6.6 ppt. At Queen Lane 2, average PFOS concentration was 4.8 ppt, ranging from 3.9 ppt to 5.9 ppt. At the Belmont treatment plant, average PFOS concentration was 3.8 ppt, ranging from 2.9 ppt to 5.6 ppt (Table 2). Figure 2 shows PFOS concentrations at each site by sample date and compares results to the state of Pennsylvania's proposed maximum contaminant level (MCL) of 18 ppt for PFOS.

Table 2. PFOS Results Summary (ppt)

Location	Number of Samples	Non-detects	Minimum (ppt)	Maximum (ppt)	Average (ppt)
Baxter	15	8	2.2	5.3	3.1
Queen Lane 1	15	0	3.8	6.6	4.9
Queen Lane 2	15	0	3.9	5.9	4.8
Belmont	15	0	2.9	5.6	3.8

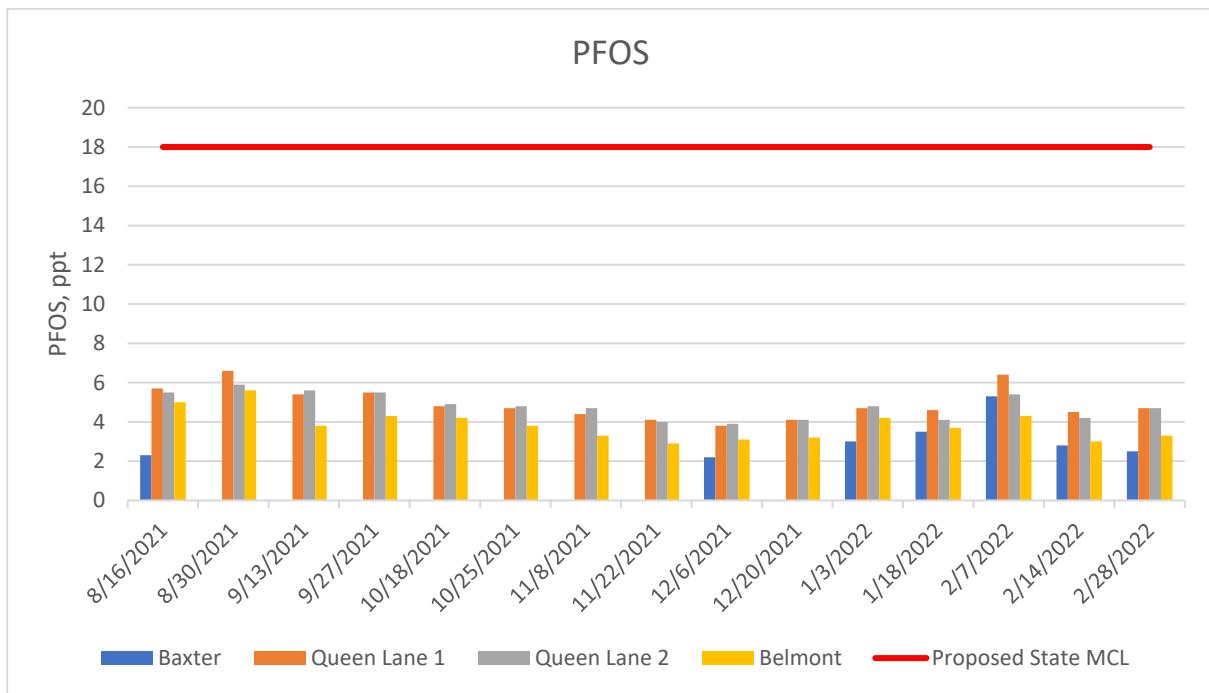


Figure 2. PFOS Results for Each Site by Sample Date (ppt)

The summary statistics from each sampling site are presented as boxplots in Figures 3 (PFOS) and 5 (PFOA). Boxplots are useful in looking at the variability of the data at each site. The end of each line extending from the box indicates that site's minimum and maximum normal results value; the

majority of each site's results fall within the range shown by the box itself. The horizontal line within each box is the median, or middle, value. The single dots appearing on the plots represent results that are considered statistical outliers.

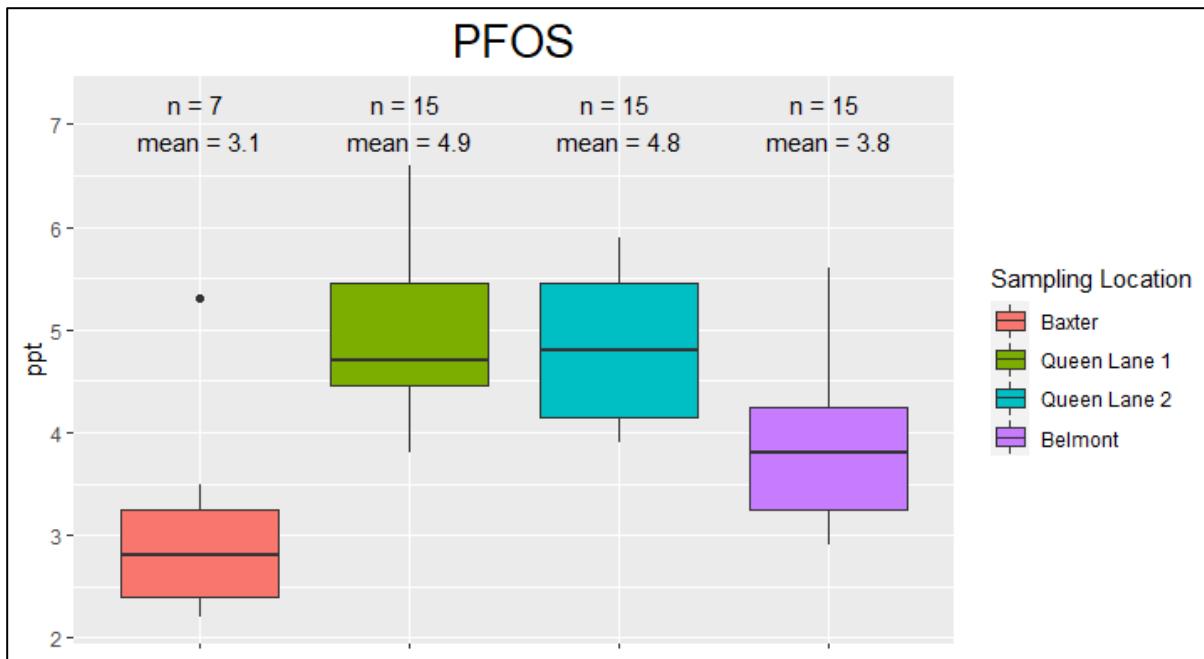


Figure 3. Boxplot of PFOS Results

Results Summary: PFOA

Samples collected from the Baxter drinking water treatment plant demonstrated an average PFOA concentration of 3.1 ppt, with results ranging from non-detection (for 2 samples) to a maximum of 8.0 ppt. Results from the two locations at the Queen Lane treatment plant were similar. At Queen Lane 1, average PFOA concentration was 7.1 ppt, ranging from 6.3 ppt to 7.8 ppt. At Queen Lane 2, average PFOA concentration was 7.1 ppt, ranging from 5.9 ppt to 7.9 ppt. At the Belmont treatment plant, average PFOA concentration was 5.9 ppt, ranging from 3.9 ppt to 7.9 ppt (Table 3). Figure 4 shows PFOA concentrations at each site by sample date and compares results to the state of Pennsylvania's proposed maximum contaminant level (MCL) of 14 ppt for PFOA.

Table 3. PFOA Results Summary (ppt)

Location	Number of Samples	Non-detects	Minimum (ppt)	Maximum (ppt)	Average (ppt)
Baxter	15	2	2.0	8.0	3.1
Queen Lane 1	15	0	6.3	7.8	7.1
Queen Lane 2	15	0	5.9	7.9	7.1
Belmont	15	0	3.9	7.9	5.9

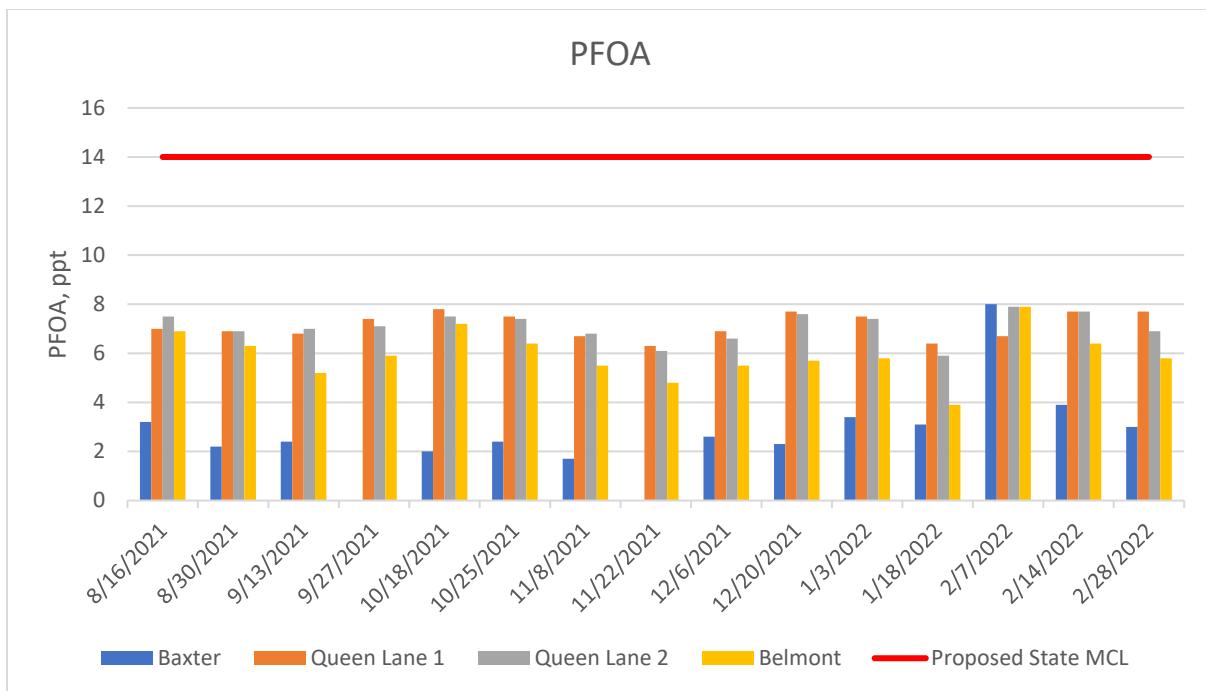


Figure 4. PFOA Results for Each Site by Sample Date (ppt)

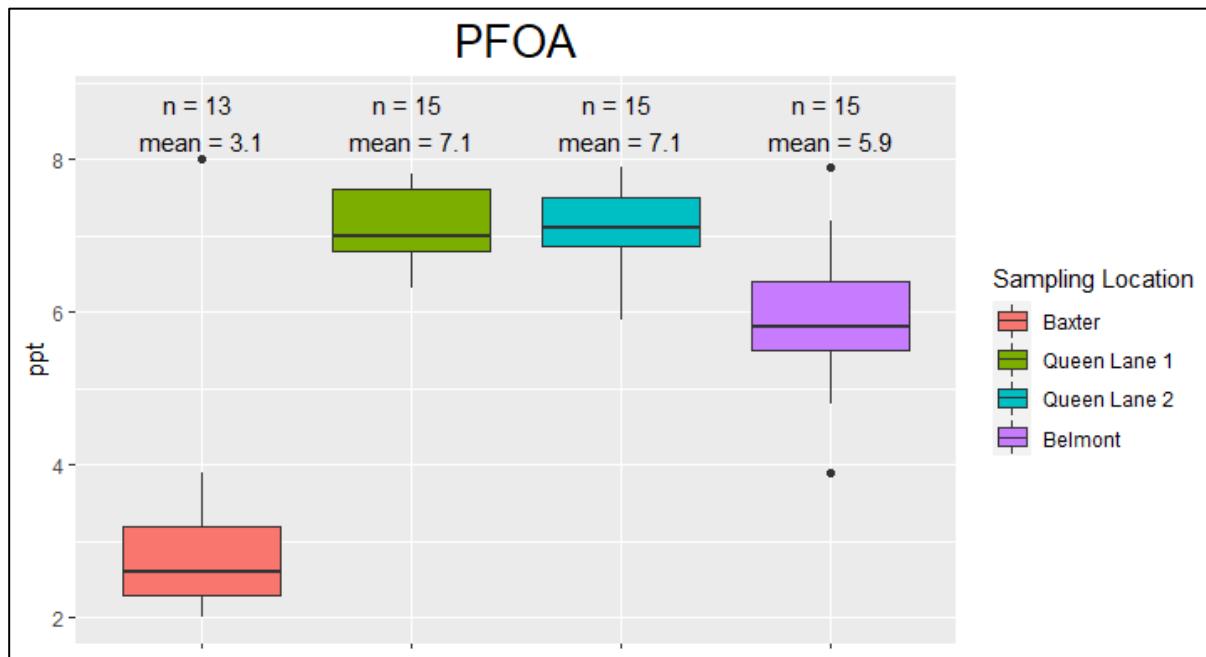


Figure 5. Boxplot of PFOA Results

Discussion

The primary goal of the PFAS Drinking Water Characterization Study is to determine baseline levels of PFAS occurring in the city's drinking water. **All PFOS results were safely below the 18 ppt maximum contaminant level (MCL) currently proposed by the state of Pennsylvania. All PFOA results were below the 14 ppt maximum contaminant level (MCL) currently proposed by the state of Pennsylvania.**

PWD will continue to follow public health research and comply with federal and state regulations and monitoring programs. Our understanding of the occurrence of PFAS in drinking water is evolving, and the data will be used to inform decisions that can help us best protect the integrity of our drinking water for generations to come.

Appendix

Table 4. PWD Drinking Water Sampling Results

Sampling Date	Site	Analyte	Result	Units
8/16/2021	Baxter	Perfluorooctanoic acid (PFOA)	3.2	ng/L
8/16/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	2.3	ng/L
8/16/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 2.0	ng/L
8/16/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 2.0	ng/L
8/16/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 2.0	ng/L
8/16/2021	Baxter	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
8/16/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
8/16/2021	Baxter	Perfluorohexanoic acid (PFHxA)	3.2	ng/L
8/16/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L
8/16/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
8/16/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
8/16/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.0	ng/L
8/16/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	5.7	ng/L
8/16/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.0	ng/L
8/16/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.0	ng/L
8/16/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.4	ng/L
8/16/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
8/16/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.5	ng/L
8/16/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	5.5	ng/L
8/16/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.1	ng/L
8/16/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	3.1	ng/L
8/16/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.6	ng/L
8/16/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L

8/16/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
8/16/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
8/16/2021	Belmont	Perfluorooctanoic acid (PFOA)	6.9	ng/L
8/16/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	5.0	ng/L
8/16/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	4.0	ng/L
8/16/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	3.2	ng/L
8/16/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 2.0	ng/L
8/16/2021	Belmont	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
8/16/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
8/16/2021	Belmont	Perfluorohexanoic acid (PFHxA)	6.0	ng/L
8/16/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L
8/16/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
8/16/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
8/16/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
8/16/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
8/30/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.2	ng/L
8/30/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.8	ng/L
8/30/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorohexanoic acid (PFHxA)	1.8	ng/L
8/30/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
8/30/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
8/30/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
8/30/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.9	ng/L
8/30/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	6.6	ng/L
8/30/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.0	ng/L
8/30/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
8/30/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L

8/30/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	4.8	ng/L
8/30/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
8/30/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	6.9	ng/L
8/30/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	5.9	ng/L
8/30/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
8/30/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
8/30/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	4.8	ng/L
8/30/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
8/30/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
8/30/2021	Belmont	Perfluorooctanoic acid (PFOA)	6.3	ng/L
8/30/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	5.6	ng/L
8/30/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
8/30/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.7	ng/L
8/30/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
8/30/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
8/30/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
8/30/2021	Belmont	Perfluorohexanoic acid (PFHxA)	4.1	ng/L
8/30/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
8/30/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
8/30/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
8/30/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
8/30/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.4	ng/L
9/13/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.8	ng/L
9/13/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L

9/13/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorohexanoic acid (PFHxA)	2.3	ng/L
9/13/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
9/13/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
9/13/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
9/13/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
9/13/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
9/13/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.8	ng/L
9/13/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	5.4	ng/L
9/13/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.5	ng/L
9/13/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.0	ng/L
9/13/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	5.2	ng/L
9/13/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/13/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/13/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/13/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
9/13/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.0	ng/L
9/13/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	5.6	ng/L
9/13/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.7	ng/L
9/13/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	3.1	ng/L
9/13/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	5.4	ng/L
9/13/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
9/13/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
9/13/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
9/13/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
9/13/2021	Belmont	Perfluorooctanoic acid (PFOA)	5.2	ng/L
9/13/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.8	ng/L
9/13/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	4.1	ng/L

9/13/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.4	ng/L
9/13/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/13/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/13/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/13/2021	Belmont	Perfluorohexanoic acid (PFHxA)	4.1	ng/L
9/13/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/13/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/13/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/13/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/13/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/13/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluoroctanoic acid (PFOA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
9/27/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorohexanoic acid (PFHxA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/27/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/27/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluoroctanoic acid (PFOA)	7.4	ng/L
9/27/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	5.5	ng/L
9/27/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.8	ng/L
9/27/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.0	ng/L
9/27/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	4.9	ng/L
9/27/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/27/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluoroctanoic acid (PFOA)	7.1	ng/L

9/27/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	5.5	ng/L
9/27/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
9/27/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.9	ng/L
9/27/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	4.9	ng/L
9/27/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/27/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
9/27/2021	Belmont	Perfluorooctanoic acid (PFOA)	5.9	ng/L
9/27/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	4.3	ng/L
9/27/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.4	ng/L
9/27/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.4	ng/L
9/27/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
9/27/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
9/27/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
9/27/2021	Belmont	Perfluorohexanoic acid (PFHxA)	4.0	ng/L
9/27/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
9/27/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
9/27/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
9/27/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
9/27/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.0	ng/L
10/18/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
10/18/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorohexanoic acid (PFHxA)	2.1	ng/L
10/18/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
10/18/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
10/18/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
10/18/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L

10/18/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
10/18/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.8	ng/L
10/18/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.8	ng/L
10/18/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.2	ng/L
10/18/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
10/18/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	1.7	ng/L
10/18/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
10/18/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
10/18/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	5.9	ng/L
10/18/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
10/18/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
10/18/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
10/18/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
10/18/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
10/18/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
10/18/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.5	ng/L
10/18/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.9	ng/L
10/18/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.7	ng/L
10/18/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.7	ng/L
10/18/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	1.9	ng/L
10/18/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
10/18/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
10/18/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.3	ng/L
10/18/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
10/18/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
10/18/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
10/18/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/18/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/18/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
10/18/2021	Belmont	Perfluorooctanoic acid (PFOA)	7.2	ng/L
10/18/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	4.2	ng/L
10/18/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	4.6	ng/L
10/18/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
10/18/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
10/18/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
10/18/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
10/18/2021	Belmont	Perfluorohexanoic acid (PFHxA)	5.8	ng/L
10/18/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
10/18/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
10/18/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L

10/18/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/18/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/18/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.4	ng/L
10/25/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.8	ng/L
10/25/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorohexanoic acid (PFHxA)	2.5	ng/L
10/25/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
10/25/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
10/25/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/25/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/25/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
10/25/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.5	ng/L
10/25/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.7	ng/L
10/25/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.6	ng/L
10/25/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.9	ng/L
10/25/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	1.9	ng/L
10/25/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
10/25/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
10/25/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.5	ng/L
10/25/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
10/25/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
10/25/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
10/25/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
10/25/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
10/25/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.4	ng/L
10/25/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.8	ng/L
10/25/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.9	ng/L
10/25/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
10/25/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.3	ng/L
10/25/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L

10/25/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
10/25/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
10/25/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
10/25/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
10/25/2021	Belmont	Perfluorooctanoic acid (PFOA)	6.4	ng/L
10/25/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.8	ng/L
10/25/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	4.7	ng/L
10/25/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.7	ng/L
10/25/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
10/25/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
10/25/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
10/25/2021	Belmont	Perfluorohexanoic acid (PFHxA)	5.2	ng/L
10/25/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
10/25/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
10/25/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
10/25/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/25/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
10/25/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
11/8/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.1	ng/L
11/8/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.7	ng/L
11/8/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorohexanoic acid (PFHxA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/8/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/8/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.8	ng/L
11/8/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.4	ng/L
11/8/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.0	ng/L
11/8/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.4	ng/L
11/8/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L

11/8/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	5.0	ng/L
11/8/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/8/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	6.8	ng/L
11/8/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.7	ng/L
11/8/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.2	ng/L
11/8/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.6	ng/L
11/8/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	5.1	ng/L
11/8/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/8/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/8/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/8/2021	Belmont	Perfluorooctanoic acid (PFOA)	5.5	ng/L
11/8/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.3	ng/L
11/8/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.9	ng/L
11/8/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.2	ng/L
11/8/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
11/8/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
11/8/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
11/8/2021	Belmont	Perfluorohexanoic acid (PFHxA)	3.9	ng/L
11/8/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
11/8/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
11/8/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
11/8/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
11/8/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
11/8/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
11/22/2021	Baxter	Perfluorooctanoic acid (PFOA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.7	ng/L
11/22/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L

11/22/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorohexanoic acid (PFHxA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/22/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/22/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.3	ng/L
11/22/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.1	ng/L
11/22/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.8	ng/L
11/22/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.4	ng/L
11/22/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	4.9	ng/L
11/22/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/22/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	6.1	ng/L
11/22/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.0	ng/L
11/22/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
11/22/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.3	ng/L
11/22/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	4.8	ng/L
11/22/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/22/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
11/22/2021	Belmont	Perfluorooctanoic acid (PFOA)	4.8	ng/L
11/22/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	2.9	ng/L
11/22/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.4	ng/L

11/22/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.0	ng/L
11/22/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
11/22/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
11/22/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
11/22/2021	Belmont	Perfluorohexanoic acid (PFHxA)	3.7	ng/L
11/22/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
11/22/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
11/22/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
11/22/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
11/22/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
12/6/2021	Baxter	Perfluoroctanoic acid (PFOA)	2.6	ng/L
12/6/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	2.2	ng/L
12/6/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
12/6/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
12/6/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/6/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/6/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/6/2021	Baxter	Perfluorohexanoic acid (PFHxA)	2.1	ng/L
12/6/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/6/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/6/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/6/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluoroctanoic acid (PFOA)	6.9	ng/L
12/6/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	3.8	ng/L
12/6/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.8	ng/L
12/6/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.5	ng/L
12/6/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	5.5	ng/L
12/6/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/6/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluoroctanoic acid (PFOA)	6.6	ng/L

12/6/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	3.9	ng/L
12/6/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.9	ng/L
12/6/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.5	ng/L
12/6/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	5.4	ng/L
12/6/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/6/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/6/2021	Belmont	Perfluorooctanoic acid (PFOA)	5.5	ng/L
12/6/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.1	ng/L
12/6/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.6	ng/L
12/6/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.3	ng/L
12/6/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/6/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/6/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/6/2021	Belmont	Perfluorohexanoic acid (PFHxA)	4.5	ng/L
12/6/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/6/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/6/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/6/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/6/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorooctanoic acid (PFOA)	2.3	ng/L
12/20/2021	Baxter	Perfluorooctanesulfonic acid (PFOS)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
12/20/2021	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorohexanoic acid (PFHxA)	2.4	ng/L
12/20/2021	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/20/2021	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/20/2021	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/20/2021	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L

12/20/2021	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.7	ng/L
12/20/2021	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.1	ng/L
12/20/2021	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	4.2	ng/L
12/20/2021	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.9	ng/L
12/20/2021	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	7.3	ng/L
12/20/2021	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/20/2021	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/20/2021	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/20/2021	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.6	ng/L
12/20/2021	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.1	ng/L
12/20/2021	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	4.2	ng/L
12/20/2021	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	3.3	ng/L
12/20/2021	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	7.8	ng/L
12/20/2021	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
12/20/2021	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/20/2021	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
12/20/2021	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
12/20/2021	Belmont	Perfluorooctanoic acid (PFOA)	5.7	ng/L
12/20/2021	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.2	ng/L
12/20/2021	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.8	ng/L
12/20/2021	Belmont	Perfluoroheptanoic acid (PFHpA)	2.5	ng/L
12/20/2021	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
12/20/2021	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
12/20/2021	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
12/20/2021	Belmont	Perfluorohexanoic acid (PFHxA)	5.5	ng/L
12/20/2021	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
12/20/2021	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
12/20/2021	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L

12/20/2021	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
12/20/2021	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
12/20/2021	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
1/3/2022	Baxter	Perfluorooctanoic acid (PFOA)	3.4	ng/L
1/3/2022	Baxter	Perfluorooctanesulfonic acid (PFOS)	3.0	ng/L
1/3/2022	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.7	ng/L
1/3/2022	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.7	ng/L
1/3/2022	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.7	ng/L
1/3/2022	Baxter	Perfluorononanoic acid (PFNA)	< 1.7	ng/L
1/3/2022	Baxter	Perfluorodecanoic acid (PFDA)	< 1.7	ng/L
1/3/2022	Baxter	Perfluorohexanoic acid (PFHxA)	3.1	ng/L
1/3/2022	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.7	ng/L
1/3/2022	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.7	ng/L
1/3/2022	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.7	ng/L
1/3/2022	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
1/3/2022	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.7	ng/L
1/3/2022	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.7	ng/L
1/3/2022	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.5	ng/L
1/3/2022	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.7	ng/L
1/3/2022	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.9	ng/L
1/3/2022	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.1	ng/L
1/3/2022	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	1.9	ng/L
1/3/2022	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
1/3/2022	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
1/3/2022	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.8	ng/L
1/3/2022	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
1/3/2022	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
1/3/2022	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
1/3/2022	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.4	ng/L
1/3/2022	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.8	ng/L
1/3/2022	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.9	ng/L
1/3/2022	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	3.2	ng/L
1/3/2022	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	7.2	ng/L
1/3/2022	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L

1/3/2022	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
1/3/2022	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
1/3/2022	Belmont	Perfluorooctanoic acid (PFOA)	5.8	ng/L
1/3/2022	Belmont	Perfluorooctanesulfonic acid (PFOS)	4.2	ng/L
1/3/2022	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.5	ng/L
1/3/2022	Belmont	Perfluoroheptanoic acid (PFHpA)	2.8	ng/L
1/3/2022	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
1/3/2022	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
1/3/2022	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
1/3/2022	Belmont	Perfluorohexanoic acid (PFHxA)	5.2	ng/L
1/3/2022	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
1/3/2022	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
1/3/2022	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
1/3/2022	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/3/2022	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
1/18/2022	Baxter	Perfluorooctanoic acid (PFOA)	3.1	ng/L
1/18/2022	Baxter	Perfluorooctanesulfonic acid (PFOS)	3.5	ng/L
1/18/2022	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
1/18/2022	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
1/18/2022	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
1/18/2022	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
1/18/2022	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
1/18/2022	Baxter	Perfluorohexanoic acid (PFHxA)	3.0	ng/L
1/18/2022	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
1/18/2022	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
1/18/2022	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
1/18/2022	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
1/18/2022	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
1/18/2022	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
1/18/2022	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.4	ng/L
1/18/2022	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.6	ng/L
1/18/2022	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.8	ng/L
1/18/2022	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	2.6	ng/L
1/18/2022	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
1/18/2022	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
1/18/2022	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L

1/18/2022	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	5.6	ng/L
1/18/2022	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
1/18/2022	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
1/18/2022	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
1/18/2022	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/18/2022	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/18/2022	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
1/18/2022	Queen Lane 2	Perfluorooctanoic acid (PFOA)	5.9	ng/L
1/18/2022	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.1	ng/L
1/18/2022	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
1/18/2022	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.6	ng/L
1/18/2022	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.1	ng/L
1/18/2022	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
1/18/2022	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
1/18/2022	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
1/18/2022	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
1/18/2022	Belmont	Perfluorooctanoic acid (PFOA)	3.9	ng/L
1/18/2022	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.7	ng/L
1/18/2022	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.3	ng/L
1/18/2022	Belmont	Perfluoroheptanoic acid (PFHpA)	2.4	ng/L
1/18/2022	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
1/18/2022	Belmont	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
1/18/2022	Belmont	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
1/18/2022	Belmont	Perfluorohexanoic acid (PFHxA)	4.9	ng/L
1/18/2022	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
1/18/2022	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
1/18/2022	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
1/18/2022	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/18/2022	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
1/18/2022	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
2/7/2022	Baxter	Perfluorooctanoic acid (PFOA)	8.0	ng/L
2/7/2022	Baxter	Perfluorooctanesulfonic acid (PFOS)	5.3	ng/L
2/7/2022	Baxter	Perfluorobutanesulfonic acid (PFBS)	3.0	ng/L
2/7/2022	Baxter	Perfluoroheptanoic acid (PFHpA)	4.0	ng/L
2/7/2022	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L

2/7/2022	Baxter	Perfluorononanoic acid (PFNA)	1.9	ng/L
2/7/2022	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/7/2022	Baxter	Perfluorohexanoic acid (PFHxA)	8.0	ng/L
2/7/2022	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/7/2022	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/7/2022	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/7/2022	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/7/2022	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/7/2022	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/7/2022	Queen Lane 1	Perfluorooctanoic acid (PFOA)	6.7	ng/L
2/7/2022	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	6.4	ng/L
2/7/2022	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.9	ng/L
2/7/2022	Queen Lane 1	Perfluorohexam sulfonic acid (PFHxS)	1.9	ng/L
2/7/2022	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.2	ng/L
2/7/2022	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
2/7/2022	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
2/7/2022	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
2/7/2022	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorooctanoic acid (PFOA)	7.9	ng/L
2/7/2022	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	5.4	ng/L
2/7/2022	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.2	ng/L
2/7/2022	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	4.2	ng/L
2/7/2022	Queen Lane 2	Perfluorohexam sulfonic acid (PFHxS)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	7.9	ng/L
2/7/2022	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 2.0	ng/L
2/7/2022	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
2/7/2022	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 2.0	ng/L
2/7/2022	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 2.0	ng/L
2/7/2022	Belmont	Perfluorooctanoic acid (PFOA)	7.9	ng/L
2/7/2022	Belmont	Perfluorooctanesulfonic acid (PFOS)	4.3	ng/L
2/7/2022	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.0	ng/L

2/7/2022	Belmont	Perfluoroheptanoic acid (PFHpA)	4.4	ng/L
2/7/2022	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/7/2022	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/7/2022	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/7/2022	Belmont	Perfluorohexanoic acid (PFHxA)	6.7	ng/L
2/7/2022	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/7/2022	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/7/2022	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/7/2022	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/7/2022	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/7/2022	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/14/2022	Baxter	Perfluoroctanoic acid (PFOA)	3.9	ng/L
2/14/2022	Baxter	Perfluorooctanesulfonic acid (PFOS)	2.8	ng/L
2/14/2022	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
2/14/2022	Baxter	Perfluoroheptanoic acid (PFHpA)	2.2	ng/L
2/14/2022	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/14/2022	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/14/2022	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/14/2022	Baxter	Perfluorohexanoic acid (PFHxA)	4.3	ng/L
2/14/2022	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/14/2022	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/14/2022	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/14/2022	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluoroctanoic acid (PFOA)	7.7	ng/L
2/14/2022	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.5	ng/L
2/14/2022	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.7	ng/L
2/14/2022	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	4.0	ng/L
2/14/2022	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.6	ng/L
2/14/2022	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/14/2022	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluoroctanoic acid (PFOA)	7.7	ng/L

2/14/2022	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.2	ng/L
2/14/2022	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.5	ng/L
2/14/2022	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	3.6	ng/L
2/14/2022	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.3	ng/L
2/14/2022	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/14/2022	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/14/2022	Belmont	Perfluorooctanoic acid (PFOA)	6.4	ng/L
2/14/2022	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.0	ng/L
2/14/2022	Belmont	Perfluorobutanesulfonic acid (PFBS)	3.3	ng/L
2/14/2022	Belmont	Perfluoroheptanoic acid (PFHpA)	3.3	ng/L
2/14/2022	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/14/2022	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/14/2022	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/14/2022	Belmont	Perfluorohexanoic acid (PFHxA)	5.8	ng/L
2/14/2022	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/14/2022	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/14/2022	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/14/2022	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/14/2022	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorooctanoic acid (PFOA)	3.0	ng/L
2/28/2022	Baxter	Perfluorooctanesulfonic acid (PFOS)	2.5	ng/L
2/28/2022	Baxter	Perfluorobutanesulfonic acid (PFBS)	< 1.9	ng/L
2/28/2022	Baxter	Perfluoroheptanoic acid (PFHpA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorohexanoic acid (PFHxA)	2.9	ng/L
2/28/2022	Baxter	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/28/2022	Baxter	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/28/2022	Baxter	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/28/2022	Baxter	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L

2/28/2022	Baxter	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorooctanoic acid (PFOA)	7.7	ng/L
2/28/2022	Queen Lane 1	Perfluorooctanesulfonic acid (PFOS)	4.7	ng/L
2/28/2022	Queen Lane 1	Perfluorobutanesulfonic acid (PFBS)	3.4	ng/L
2/28/2022	Queen Lane 1	Perfluoroheptanoic acid (PFHpA)	3.0	ng/L
2/28/2022	Queen Lane 1	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorohexanoic acid (PFHxA)	6.0	ng/L
2/28/2022	Queen Lane 1	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L
2/28/2022	Queen Lane 1	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/28/2022	Queen Lane 1	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/28/2022	Queen Lane 1	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L
2/28/2022	Queen Lane 2	Perfluorooctanoic acid (PFOA)	6.9	ng/L
2/28/2022	Queen Lane 2	Perfluorooctanesulfonic acid (PFOS)	4.7	ng/L
2/28/2022	Queen Lane 2	Perfluorobutanesulfonic acid (PFBS)	3.2	ng/L
2/28/2022	Queen Lane 2	Perfluoroheptanoic acid (PFHpA)	2.9	ng/L
2/28/2022	Queen Lane 2	Perfluorohexanesulfonic acid (PFHxS)	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluorononanoic acid (PFNA)	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluorodecanoic acid (PFDA)	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluorohexanoic acid (PFHxA)	6.3	ng/L
2/28/2022	Queen Lane 2	Perfluorododecanoic acid (PFDoA)	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluorotridecanoic acid (PFTrDA)	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluoroundecanoic acid (PFUnA)	< 1.8	ng/L
2/28/2022	Queen Lane 2	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
2/28/2022	Queen Lane 2	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.8	ng/L
2/28/2022	Queen Lane 2	Perfluorotetradecanoic acid (PFTeDA)	< 1.8	ng/L
2/28/2022	Belmont	Perfluorooctanoic acid (PFOA)	5.8	ng/L
2/28/2022	Belmont	Perfluorooctanesulfonic acid (PFOS)	3.3	ng/L
2/28/2022	Belmont	Perfluorobutanesulfonic acid (PFBS)	2.9	ng/L
2/28/2022	Belmont	Perfluoroheptanoic acid (PFHpA)	2.7	ng/L
2/28/2022	Belmont	Perfluorohexanesulfonic acid (PFHxS)	< 1.9	ng/L
2/28/2022	Belmont	Perfluorononanoic acid (PFNA)	< 1.9	ng/L
2/28/2022	Belmont	Perfluorodecanoic acid (PFDA)	< 1.9	ng/L
2/28/2022	Belmont	Perfluorohexanoic acid (PFHxA)	4.5	ng/L
2/28/2022	Belmont	Perfluorododecanoic acid (PFDoA)	< 1.9	ng/L
2/28/2022	Belmont	Perfluorotridecanoic acid (PFTrDA)	< 1.9	ng/L
2/28/2022	Belmont	Perfluoroundecanoic acid (PFUnA)	< 1.9	ng/L

2/28/2022	Belmont	N-ethyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/28/2022	Belmont	N-methyl Perfluorooctanesulfonamidoacetic acid	< 1.9	ng/L
2/28/2022	Belmont	Perfluorotetradecanoic acid (PFTeDA)	< 1.9	ng/L